


MODEL	VRP MODEL	DATE	2018-07-37	Rev.01
VRP Tankless External Recirculation Mode (6-8units)				

VESTA DS, INC

This drawing is intended only as a guide and not as a replacement for professionally engineered project drawing. This concept system drawing does not imply compliance with local building codes. Actual installation may vary depending on installation location & parameters and it must be done in accordance to all local building codes. Verify with local building officials before commencement of system installation.

Size	Recommended Pipe size
A 1/2"	1Unit 3/4"
B 3/4"	2Units 1"
C 3/4"	3Units 1-1/4"
D 3/4"	4-5Units 1-1/2"
E 3/4"	6-8Units 2"

A  
B  
C  
D  
E

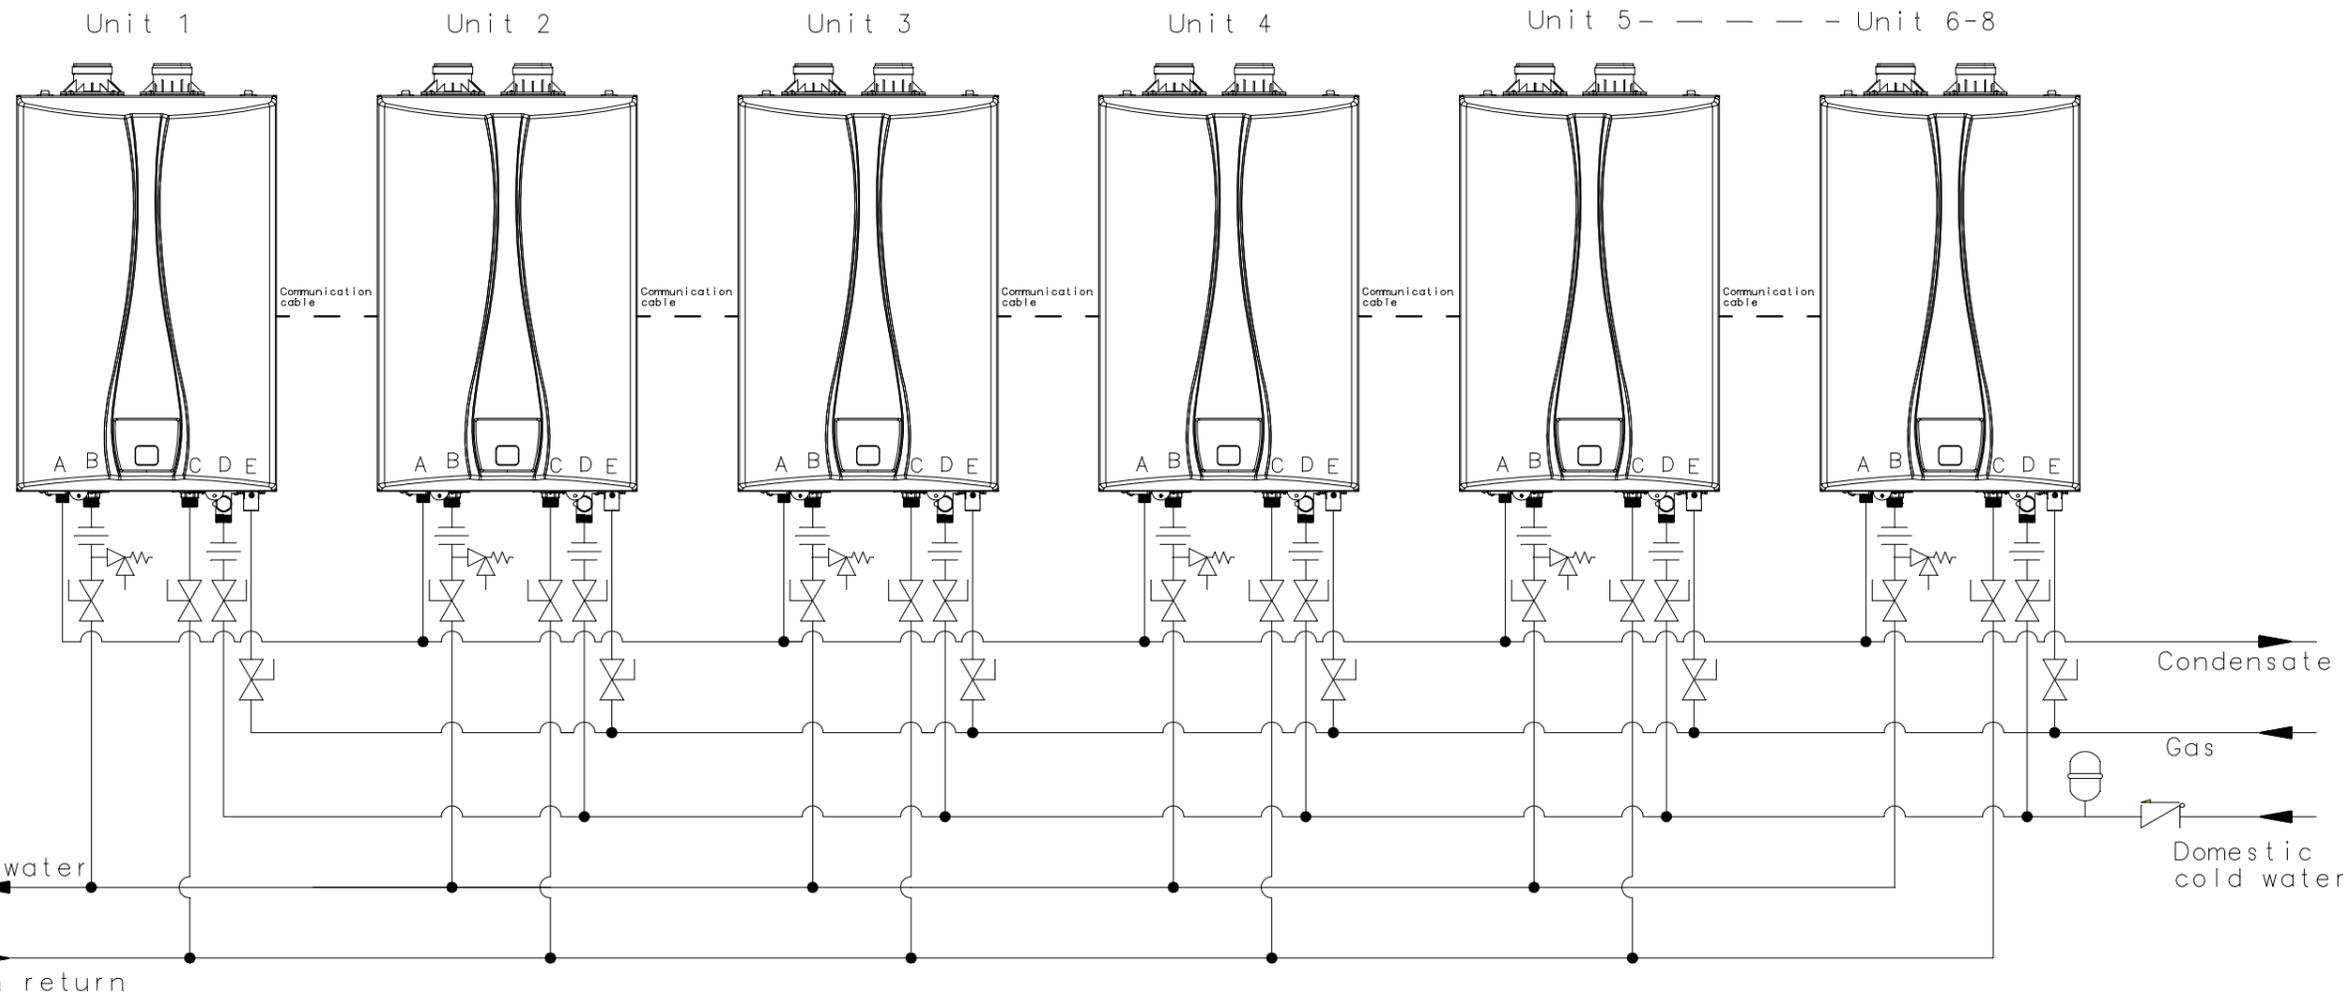

- Check valve
- Circulation pump
- Aquastat
- Pressure relief valve
- Storage vessel
- Mixing valve
- Expansion vessel
- Ball valve