
This piping drawing is intended only as a guide and not as a replacement for professional engineering project drawings. Furthermore, this concept drawing is not intended to depict all piping systems, nor does it imply compliance with local building codes. Actual installation must be performed in accordance with all local building codes. If needed, consult with local building officials before installing the water heater.

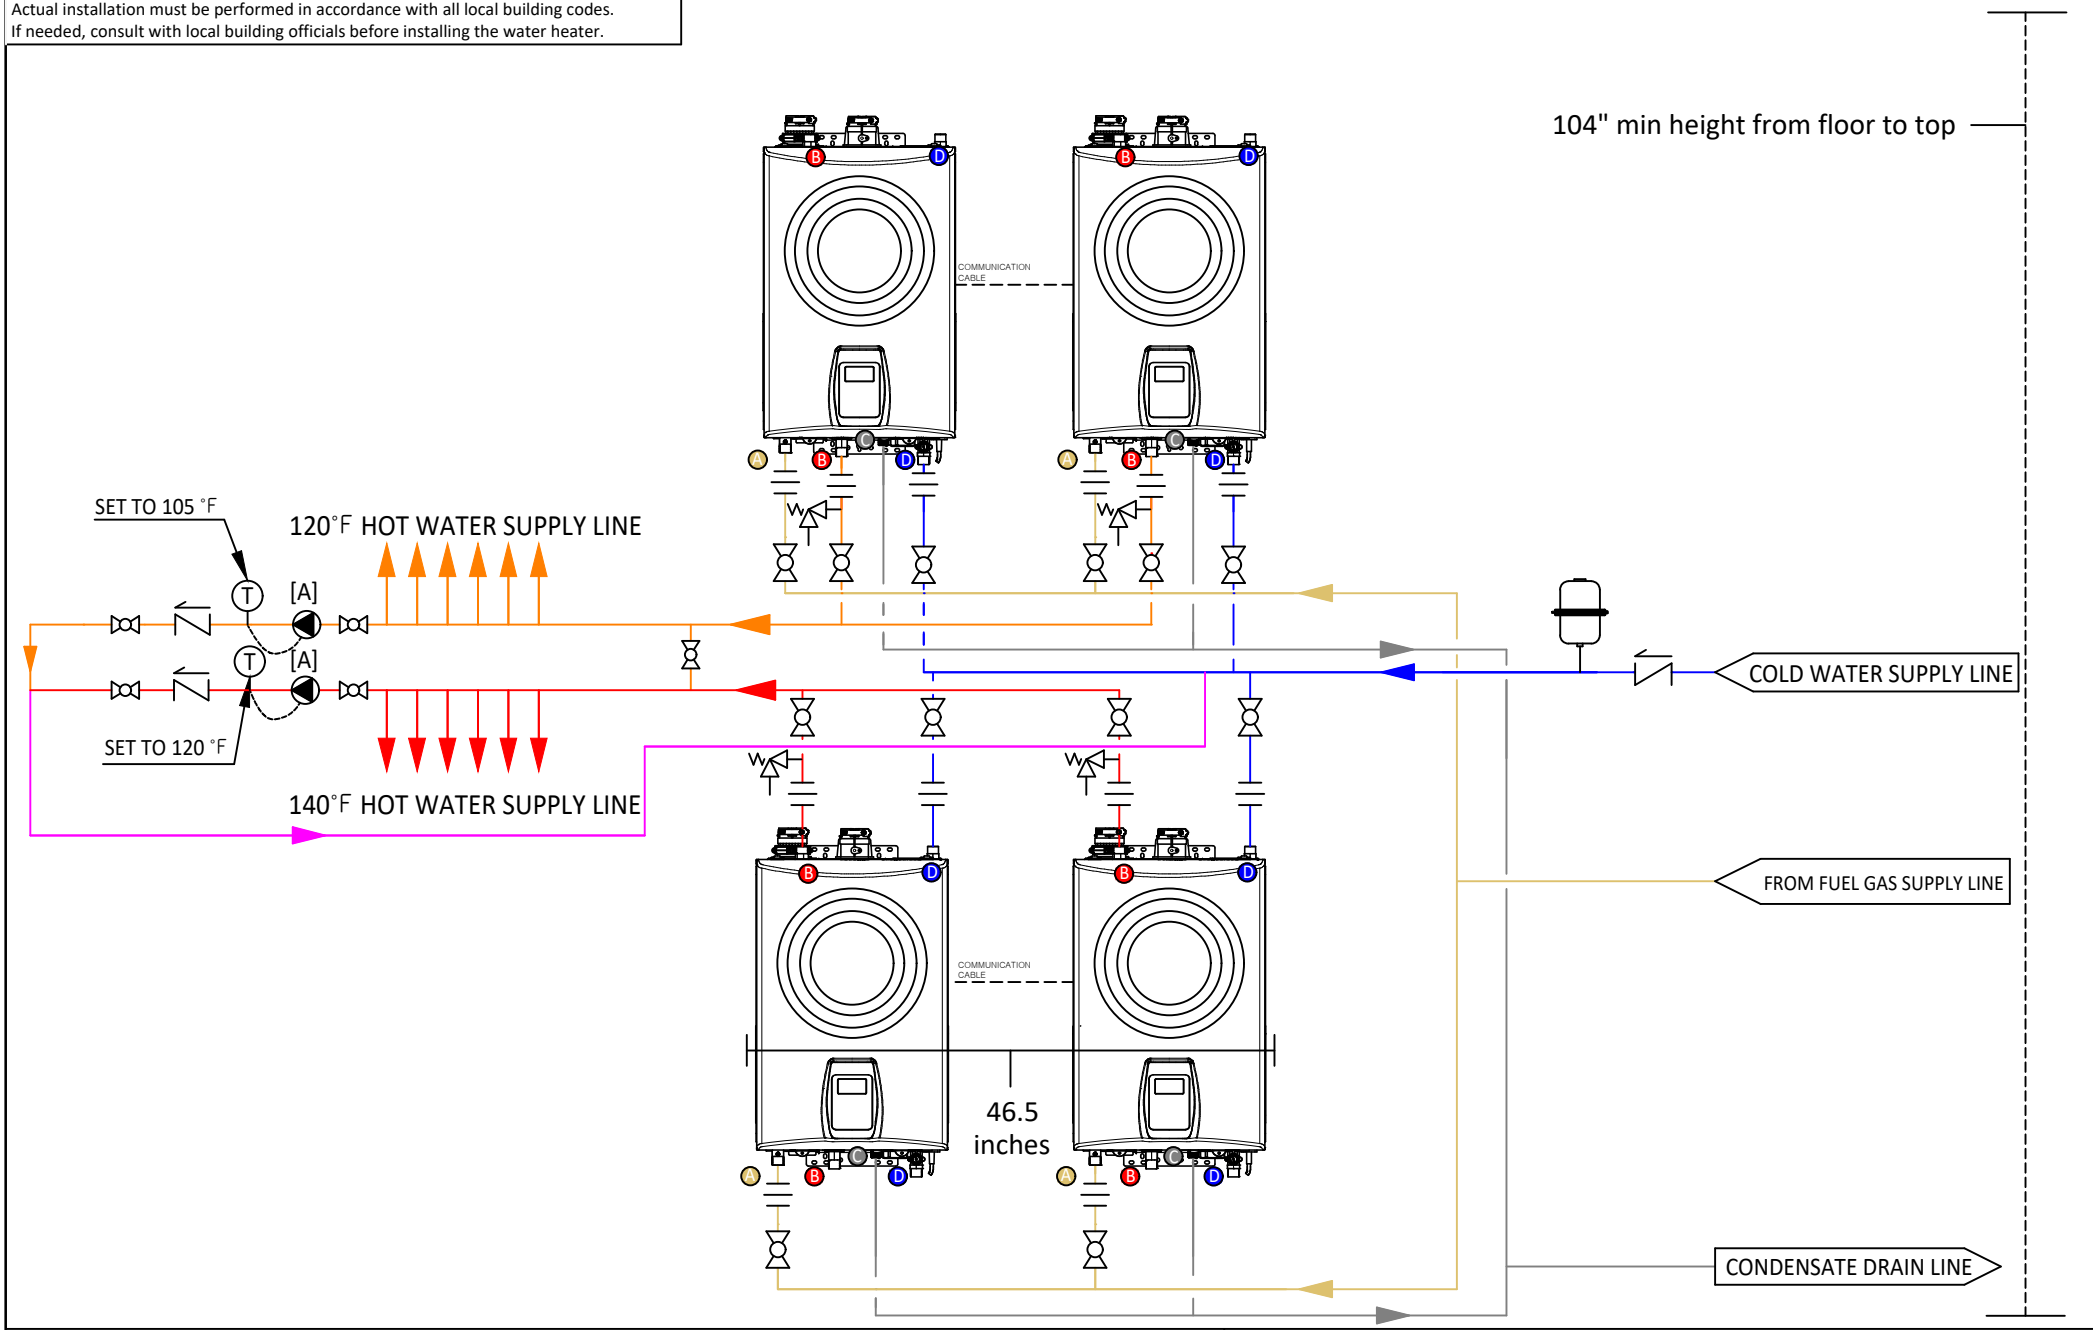

LEGEND

- UNION
- CHECK VALVE
- BALL VALVE
- CIRCULATION PUMP
- EXPANSION TANK
- PRESSURE RELIEF VALVE
- AQUASTAT

CONNECTOR SIZE		RECOMMENDED PIPE SIZE	
A	3/4 "	2 UNITS	1 "
B	3/4 "	3 UNITS	1 - 1/4 "
C	1/2 "	4-5 UNITS	1 - 1/2"
D	3/4 "	6-8 UNITS	2"
		9-14 UNITS	2 - 1/2"
		15 UNITS	3"

NOTE

1. PRIOR TO INSTALLATION, FIRST DETERMINE WHETHER THE INSTALLATION SPACE IS SUITABLE. (WHEN INSTALLING UNITS VERTICALLY, A MINIMUM HEIGHT OF 104" MUST BE SECURED.)

VESTA.DS,Inc.

VESTA.DS incorporation_401 South Dupont Ave. Ontario CA 91761

TITLE

VX WATER HEATERS (4 UNITS + EXT PUMP)
(TWO INDEPENDENT 2 UNIT CASCADES, STACKED)

DRAW NO.	DATE	SCALE	REV
VX-2-VX-2-EXT PUMP	26/6/24	NONE	1